


**NOTES:**

1. ALL SERVICE LINE WORK FROM THE MAIN TO THE BUILDING SHALL BE INSTALLED BY THE CONTRACTOR AND INSPECTED BY THE DISTRICT. PRIOR TO BACKFILLING, ALL PORTIONS OF THE SERVICE LINE TRENCH SHALL BE FILLED WITH SQUEEGEE TO A DEPTH OF 6" OVER THE TOP OF THE SERVICE LINE.
2. TRACER WIRE SHALL BE EXTENDED FROM THE MAIN ALONG THE SERVICE LINE AND BE TERMINATED IN THE METER PIT.
3. ALL PORTIONS OF SERVICE LINE FROM THE MAIN TO THE BUILDING SHALL BE CONTINUOUS WITHOUT SPLICES OR FITTINGS EXCEPT FOR THE COMPRESSION COUPLING AT THE END OF THE STUB-OUT, AND CONNECTIONS TO THE METER SETTER. SWEAT CONNECTIONS AND FITTINGS ARE STRICTLY PROHIBITED ALONG THE SERVICE LINE, INCLUDING METER PIT ASSEMBLIES.

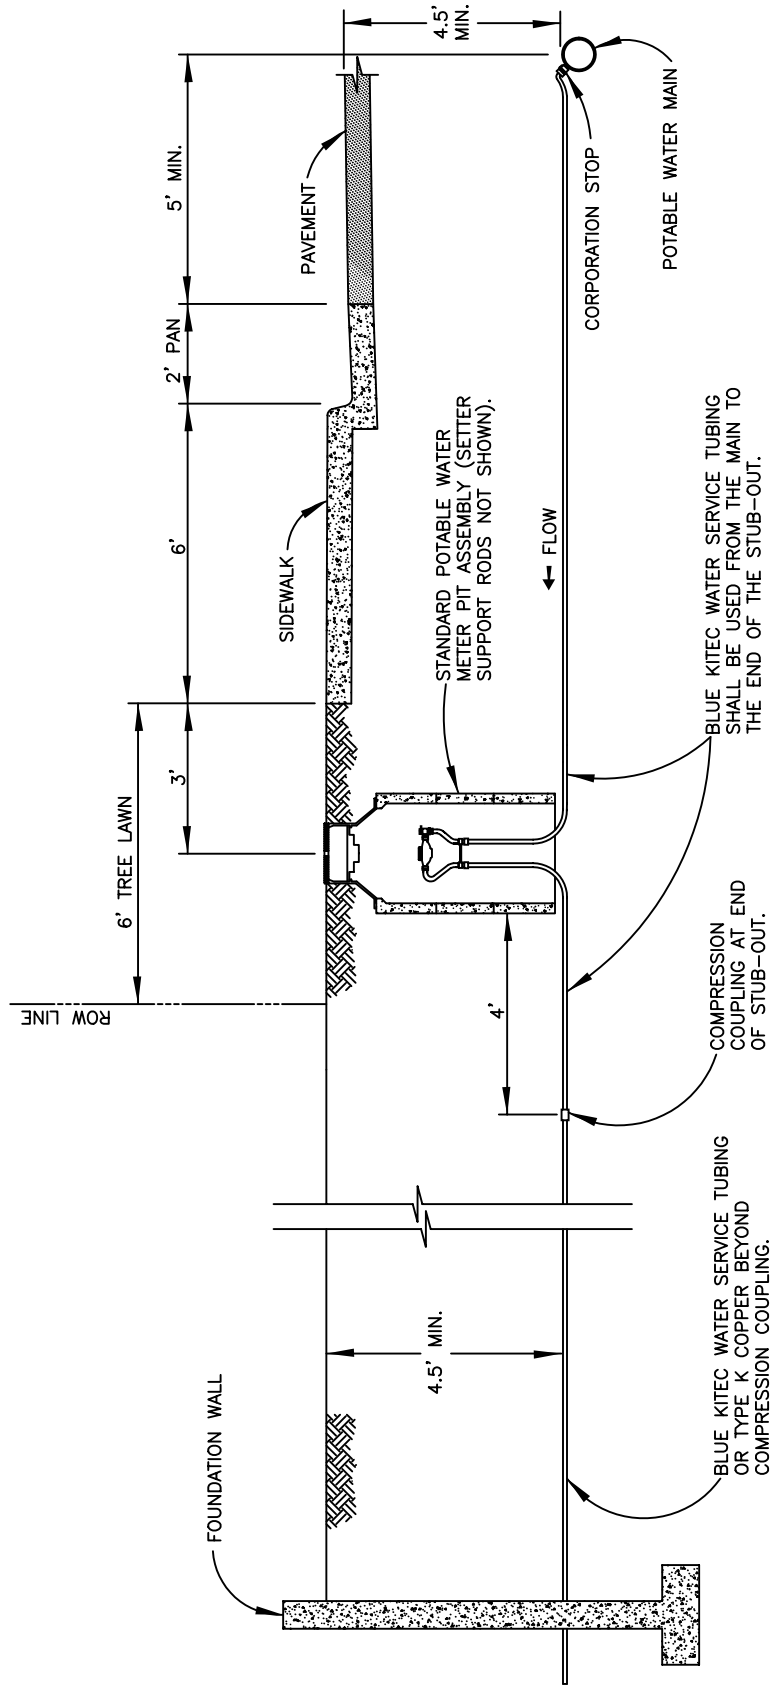

**REVISIONS:**

- 6/7/00
- 2/1/01
- 8/1/02

**SOUTH ADAMS COUNTY  
WATER AND SANITATION DISTRICT**

**POTABLE SERVICE LINE INSTALLATION  
ATTACHED WALK RESIDENTIAL SERVICE**

**WP-2**